


METER INSTALLATION GUIDE UNDERGROUND SOURCE

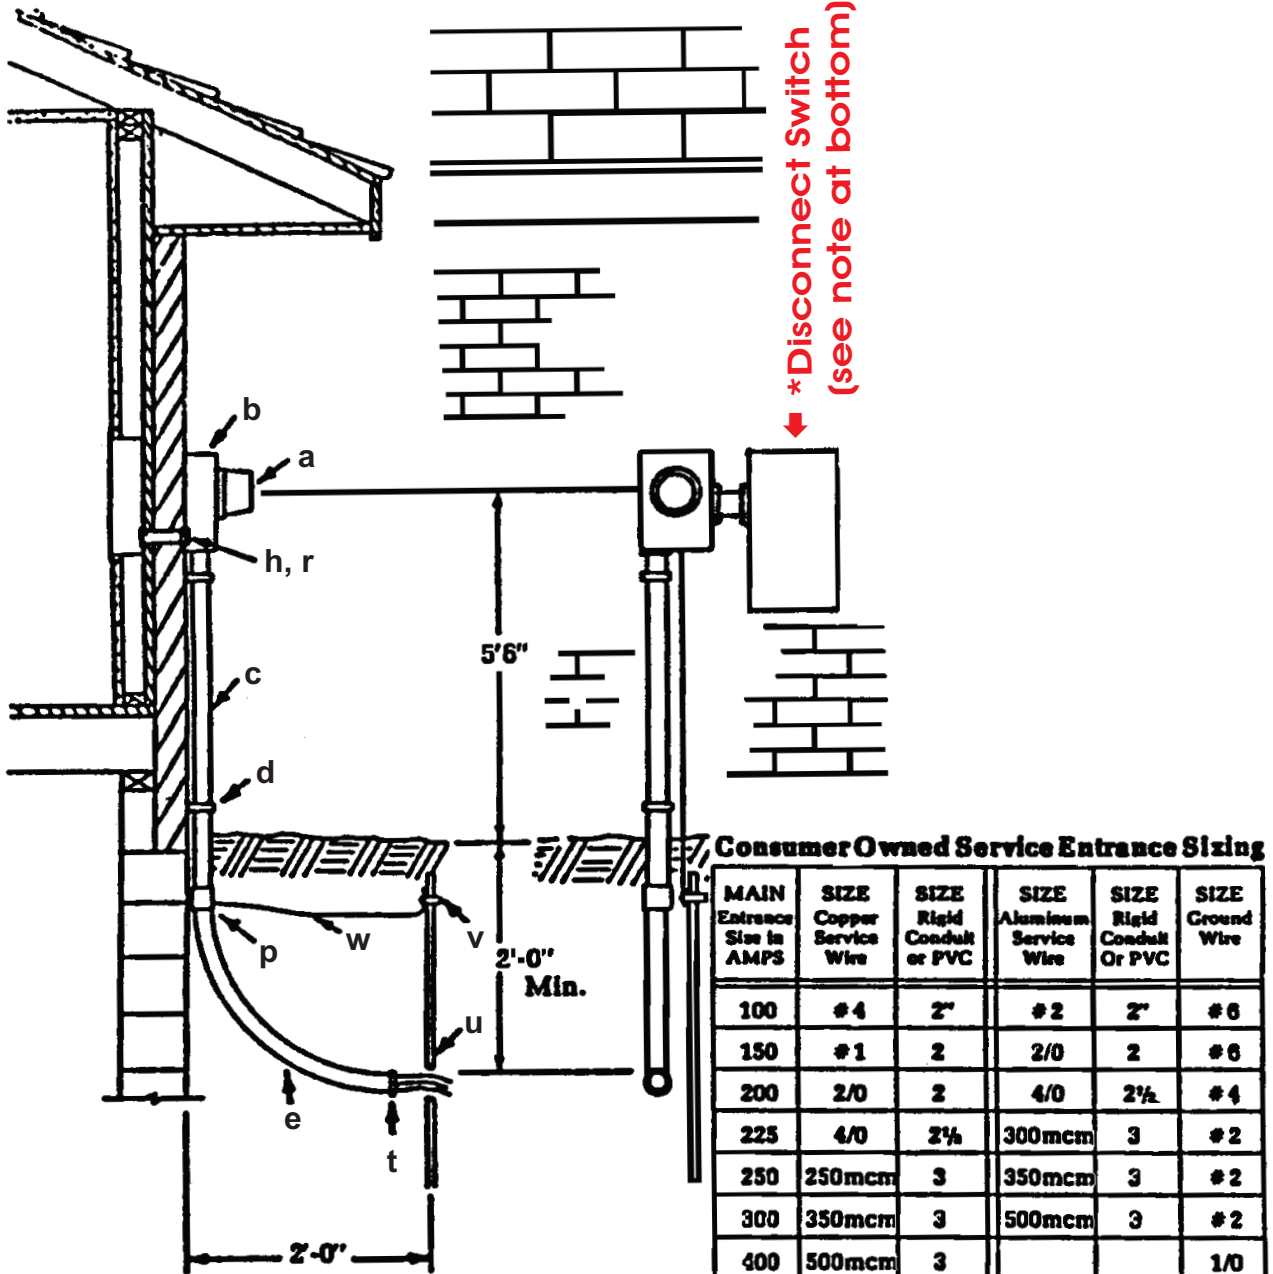

Item No.	Material	Item No.	Material
a 1	Meter	p 1	Pipe Connector
b 1	Meter Base	r 2	Conduit Locknuts Size as Required
c	Conduit Dia. and Length (see above chart)	t 3	Insulated Bushing Size as Required
d 2	Pipe Straps	u 1	8' long Grd. Rod ¼" Galv. Rod or ¼" Galv. Pipe
e 1	Factory Made Elbow Size as Required	v 1	Ground Rod Clamp
h 1	Non-Waterproof Connector Size of Conduit	w	Bare Copper Ground Wire (see above chart)

Note:

- 1 Service wires to metering point are owned and maintained by EMC.
- 2 Item b is installed by electrician working for home owner.
- 3 Items c, h and r are provided by the member.

*A Disconnect Switch is required. It should be mounted to the right of the Meter Base if a combination Meter Main is not used.